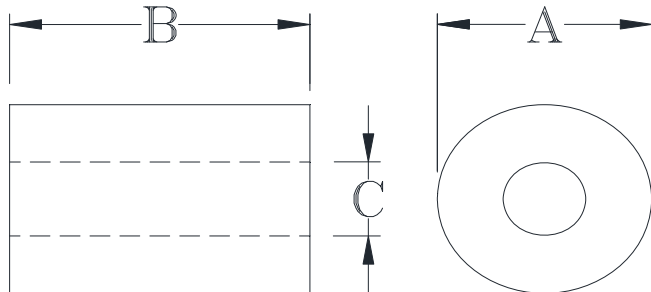


SPECIFICATION FOR APPROVAL

COMMODITY	RH CORE		SPEC NO.	SP-N250409007
ITEM	PDL3RH175095285	Green	版本：A	表單編號：QR-012-02

(1) DIMENSION: (UNIT: mm)			DIM.	TOL.
			DIM.	TOL.
		A	17.50	±0.50
		B	28.50	±0.60
		C	9.50	±0.40

(2) ELECTRICAL CHARACTERISTIC			TEST INSTRUMENTS.
IMPEDANCE at Z 1	80 (min) Ω		☒ AGILENT 4294A Precision Impedance Analyzer ☒ Agilent 4287A RF LCR Meter ☐ AGILENT 4285A Precision L.C.R. ☒ HP-4286A RF L.C.R. Meter. ☐ CHROMA 3302 Automatic Components Analyzer. ☐ WAYNE KERR 6420 Precision Impedance Analyzer. ☐ ZENTECH 1320 BIAS CURRENT. ☐ BK PRECISION 2840 DC Resistance Meter ☐ ZENTECH 502AC Resistance Merter ☐ ADEX AX-1155B DC Low Ohm Meter ☐ WAYNE KERR HI-POT TESTER 7600
IMPEDANCE at Z 2	160 (min) Ω		
TEST FREQUENCY at Z 1	25 MHz		
TEST FREQUENCY at Z 2	100 MHz		

REMARK :


- uiac : 500±25%
- Winding : ø 0.65mm*100mm 2UEW 1/2Ts

PURCHASER CONFIRMED :	APPROVED	CHECKED	DRAWN
			

TEST REPORT

SPEC NO : SP-N250409007

Typical Impedance v.s. Frequency Curve

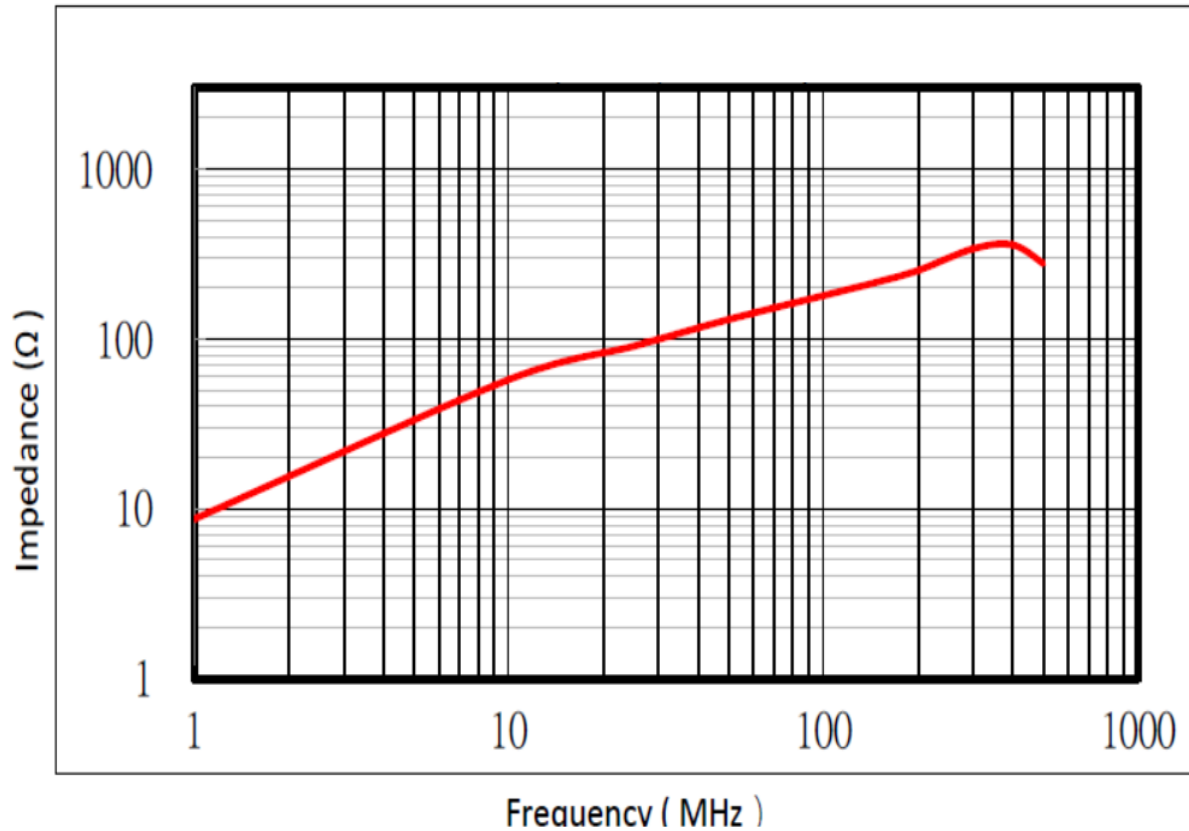

Test Instrument :

HP-4286A RF L.C.R. Meter

Testing Condition :

Temperature : 25 to 28°C

Check by :



Test by :



TEL : 886-2-2689-4971 FAX : 886-2-2689-4260
E-mail : jantek@jantek-elec.com.tw
Web-Site : www.jantek-elec.com.tw